

CHATHAM COUNTY PURCHASING DEPARTMENT

ADDENDUM NO. 3 TO BID# 21-0114-5

FOR: PURCHASE AND INSTALLATION OF AN AV SYSTEM FOR THE CHATHAM COUNTY DETENTION CENTER

PLEASE SEE THE FOLLOWING ADDITIONS, CLARIFICATIONS AND/OR CHANGES:

1. **Question:** Section 4.3.2 states “Have a minimum of one full time engineer with Certified Technology Specialist (CTS)-D certification.” What is the reason for this requirement?
Answer: The AVIXA CTS Certification is a globally accepted and industry backed certification from the largest governing body in the industry. Having manufacturer certification means you are certified to use the tools, but having an industry certification means you are certified to design, install and maintain the entire system where all the tools at your disposal are cohesively working together. The CTS-D is a design certification.
2. **Question:** Section 4.3.3 states “Have a minimum of one full time installer with CTS-1 certification.” What is the reason for this requirement?
Answer: Same answer as above. The CTS-I is an installer certification and also covers systems support and maintenance.
3. **Question:** Section 4.3.9 states “Staffed shop and office facilities within a 125 mile radius of project site.” We have a technical person within the 125 radius of project site, will this suffice?
Answer: This is to ensure that onsite support and product replacement are as less contingent upon travel and shipping delays as possible. Having a fully staffed and operational facility within a 125-mile radius helps to reduce the amount of possible “down” time we will experience whenever the system has operational issues.
4. **Question:** Did you want the vendor to supply the PC’s for the judge and clerk? You state we need to provide the monitors for them only.
Answer: Chatham County will provide the computers.
5. **Question:** Fixed mount for the monitors – was this going to be required?
Answer: Yes, the monitors need to be fixed mount to the desks.
6. **Question:** What hosting servers do you use for this courtroom live stream?
Answer: The vendor is responsible for providing streaming hardware (a codec box), the County uses a service from IBM that they will provide the IP and host information for once the system is being installed.
7. **Addition:** The County wants to add a microphone plug in plate on one side of the outside of the counsel table where the podium is going to be placed. This plug will be for a wired podium pic, gooseneck and not removable, to be wired secured and wired into the podium and plugged into this wall plate on the outside of the counsel desk. There needs to be a small amount of cabling for minor podium placement adjustments, but the length of cable left for adjustment should not be more than three (3) feet.
8. **Addition:** Three (3) speakers will need to be placed in the gallery. No volume controls should be placed in the gallery. Volume controls will be on the touchpads that control

the system located at both the judges and clerks desk. There is no preference to type/style/model.


9. **Clarification:** Please see attached drawings of courtrooms A and B.

**BID DUE DATE WILL REMAIN 2:00PM
OCTOBER 27, 2021**


BIDDER IS RESPONSIBLE FOR MAKING THE NECESSARY CHANGES.

October 20, 2021

DATE

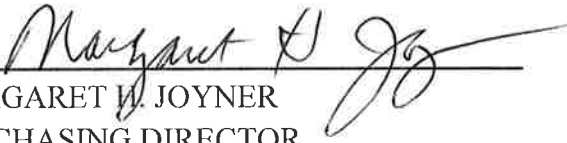
MARGARET W. JOYNER
PURCHASING DIRECTOR
CHATHAM COUNTY

CCSO Court Rooms A&B
10/14/2021

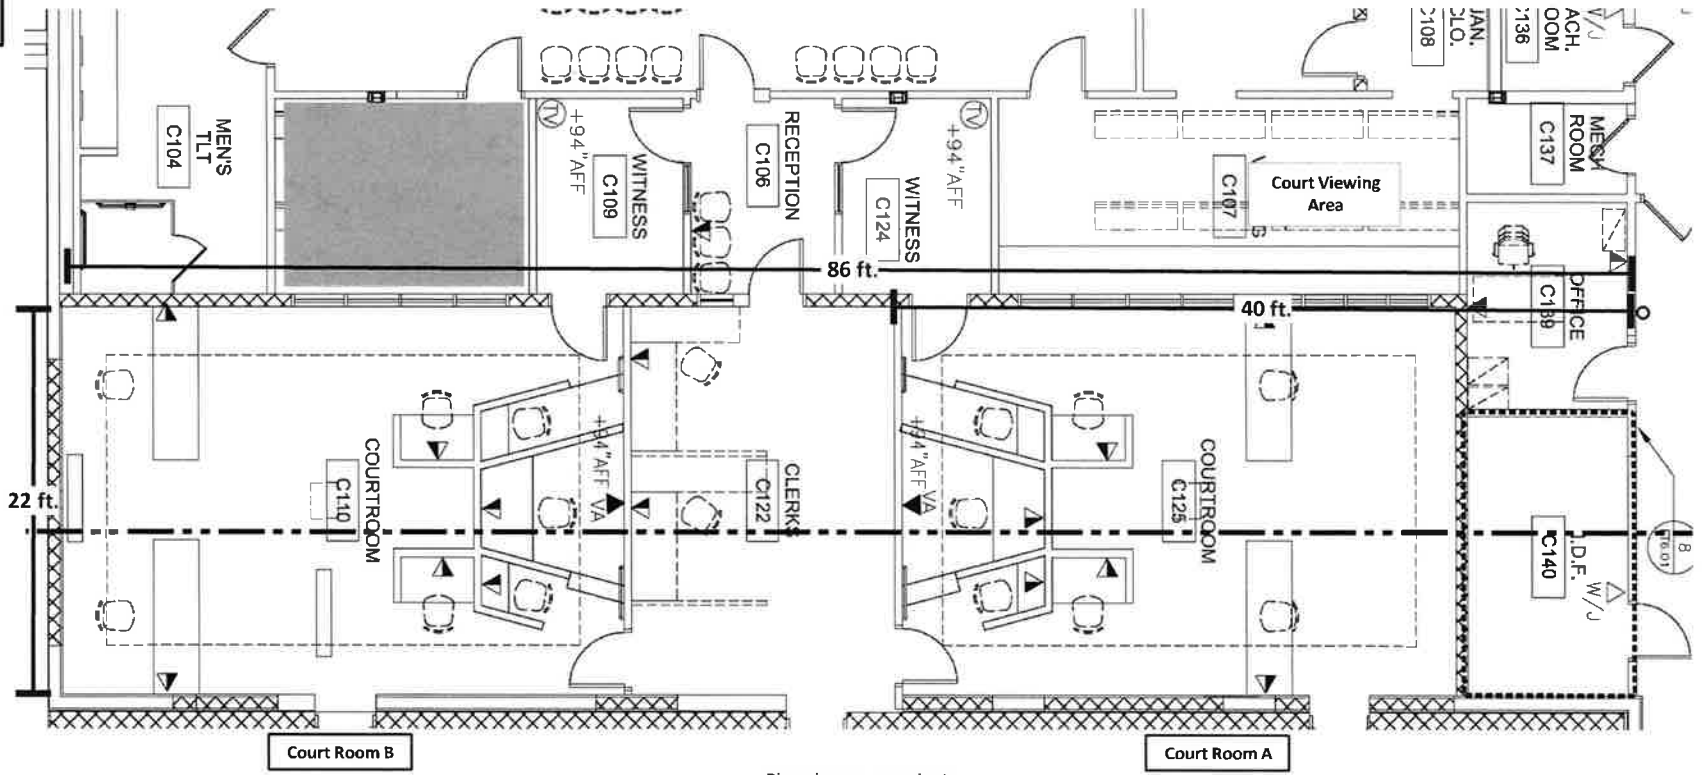

Dimensions are approximate